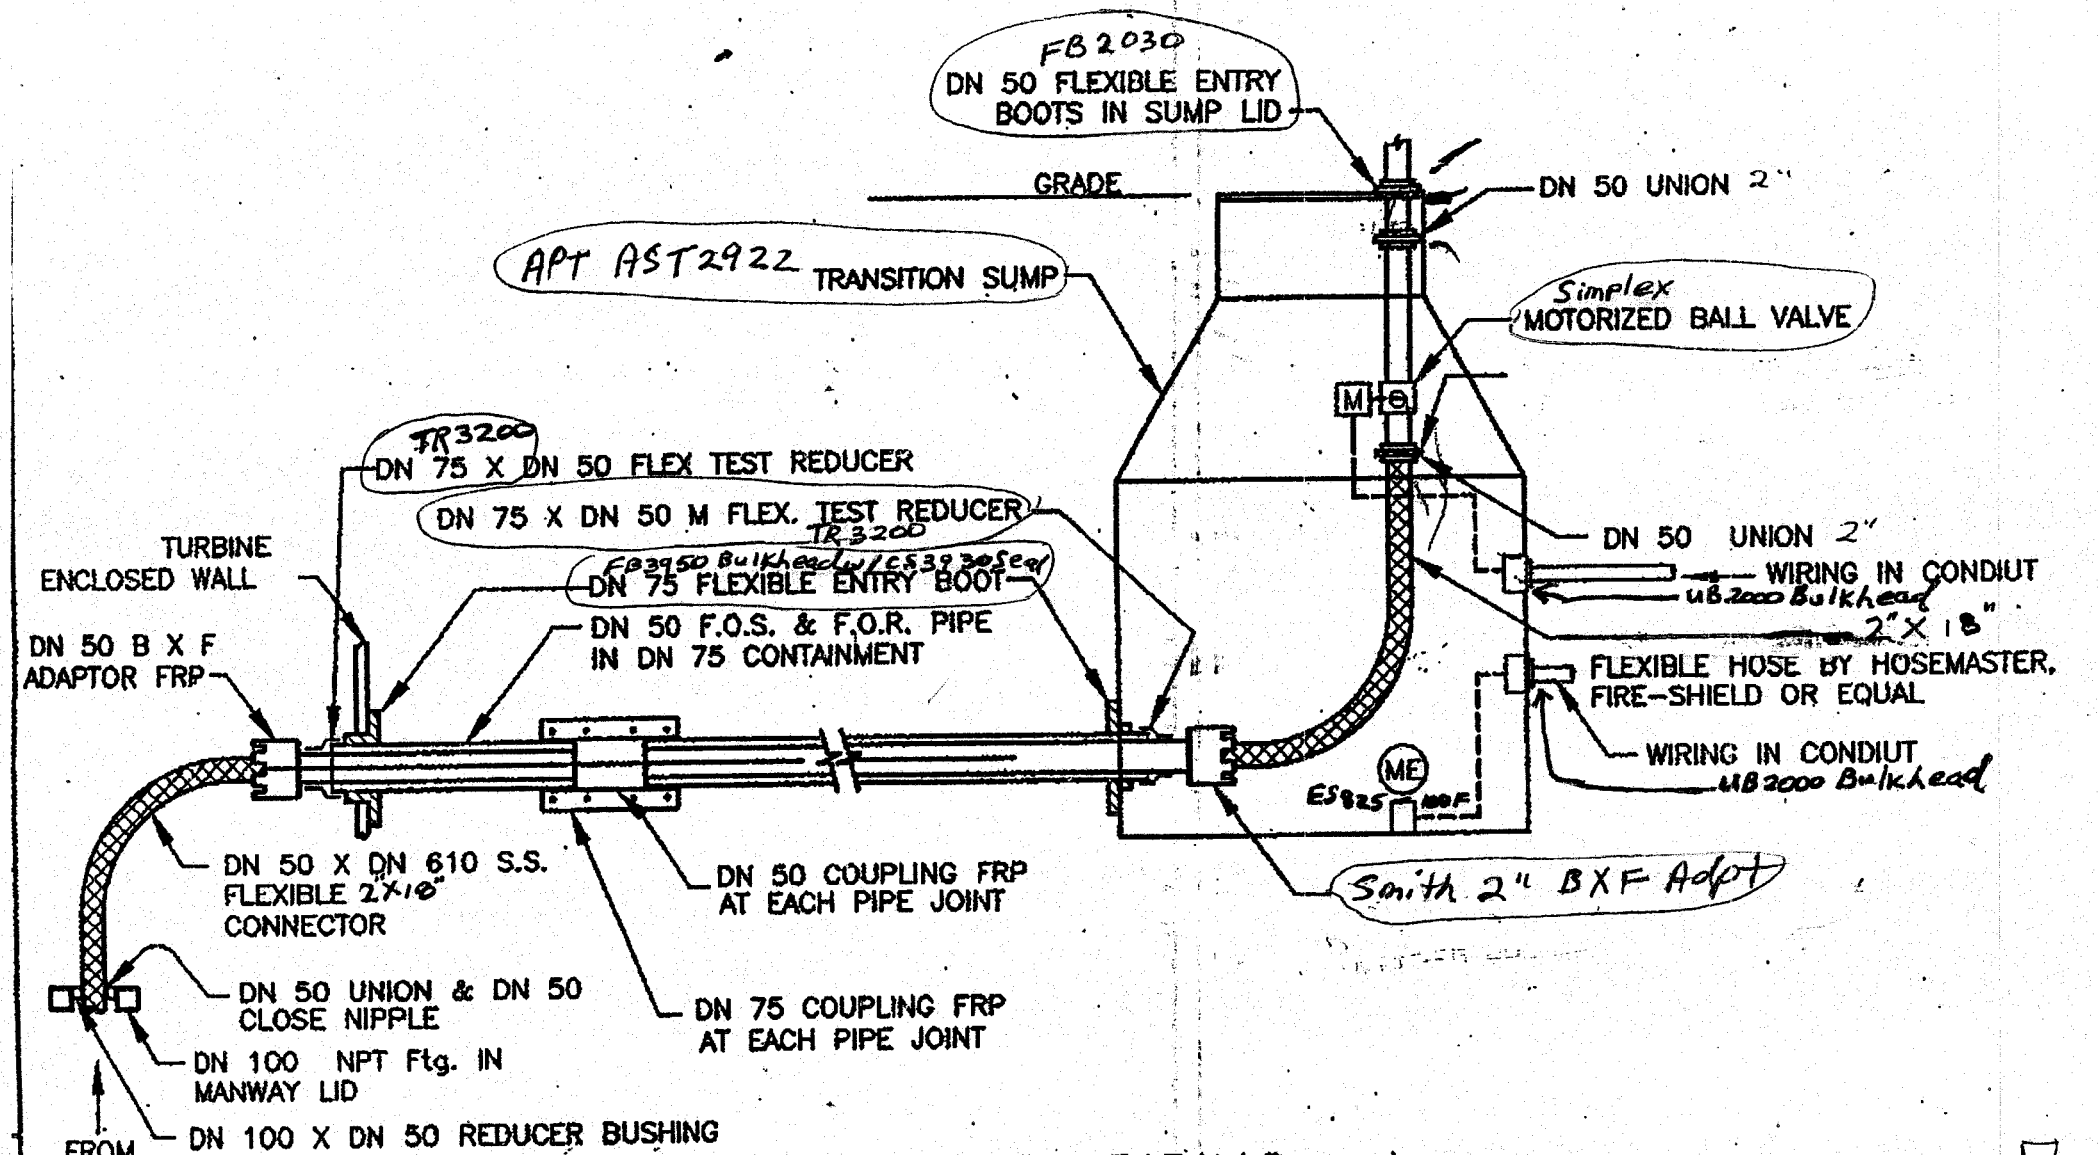

F.O.S. AND F.O.R. PIPING AT BUILDING (ONLY 1 LINE SHOWN)

7
C0.11,13 C3.32 NTS

NOTE: WIRING FOR GASOLINE PUMPS, SOLENOID VALVES AND MOISTURE LEAK DETECTOR SENSOR'S SHALL BE C1, D1.

Dwg. # 6